



City of Columbia, MO 2015 RESIDENTIAL ENERGY CODE REQUIREMENTS DIAGRAM

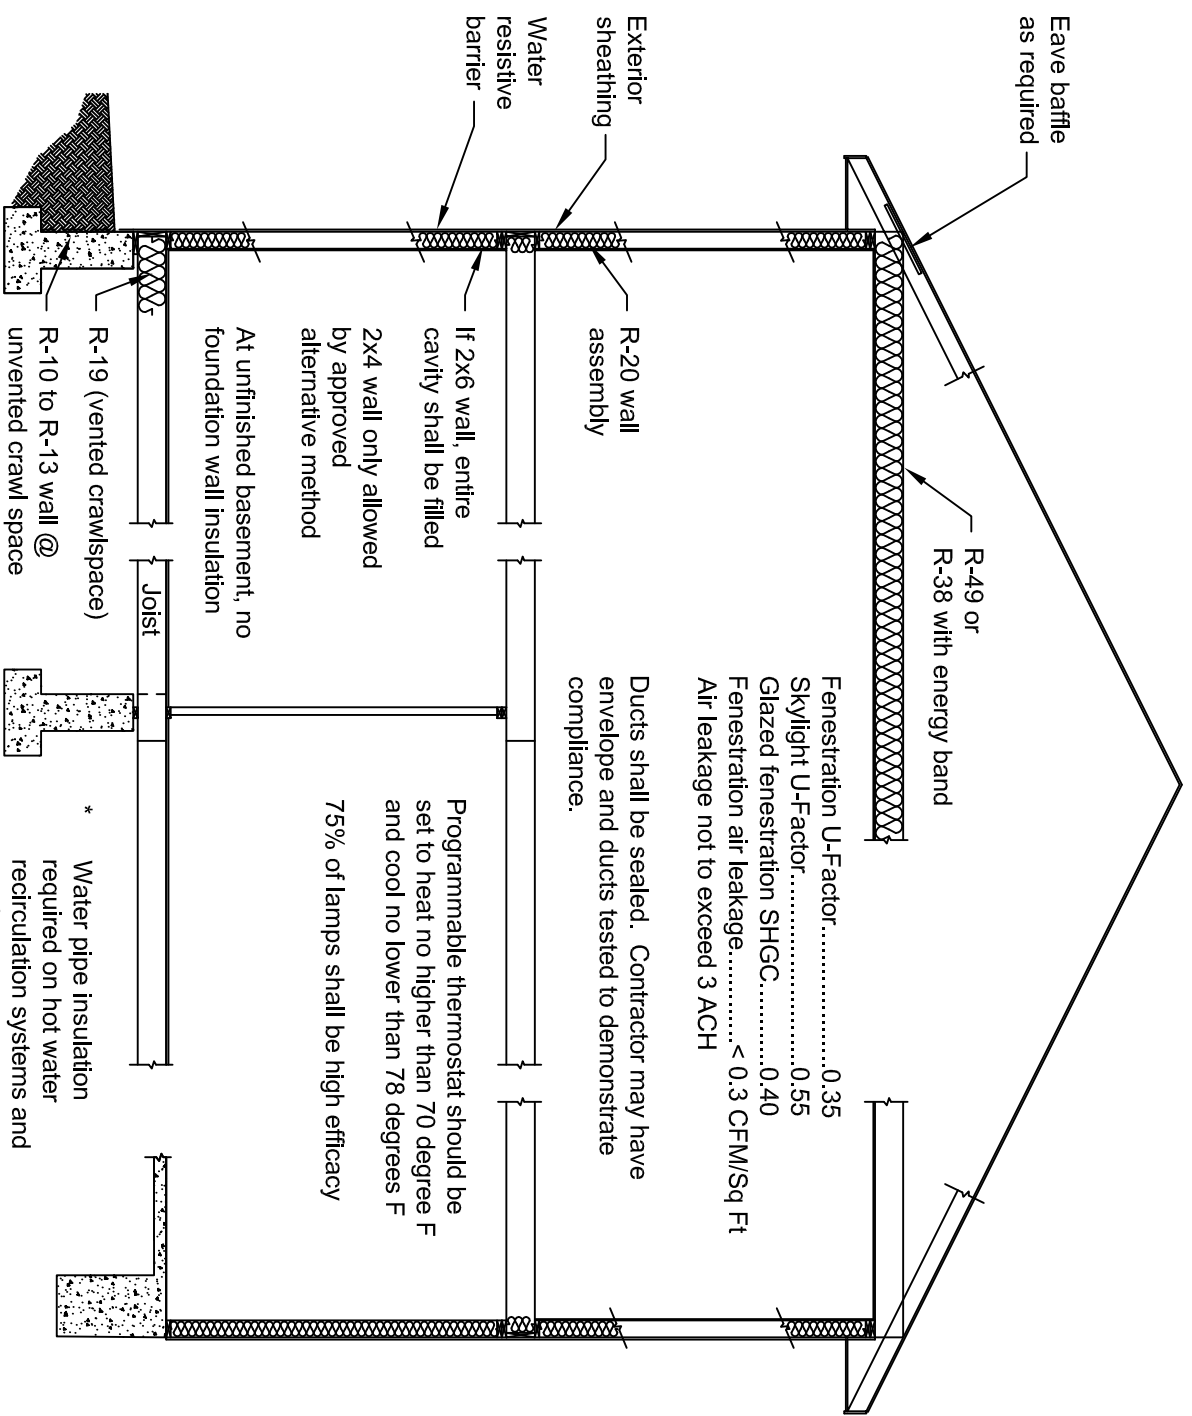

1,500 SF or less - 4" dia.
 1,501 - 2,400 SF - 6" dia
 2,401 SF or more - 8" dia

with balancing damper and connected to return air or HVAC unit ahead of filter

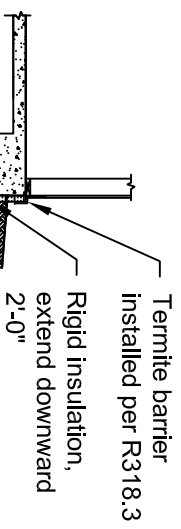

OPTIONAL